




SOUTHWEST GAS CORPORATION

Gas Meter Installation Requirements

Regulator Vent Clearance Requirements

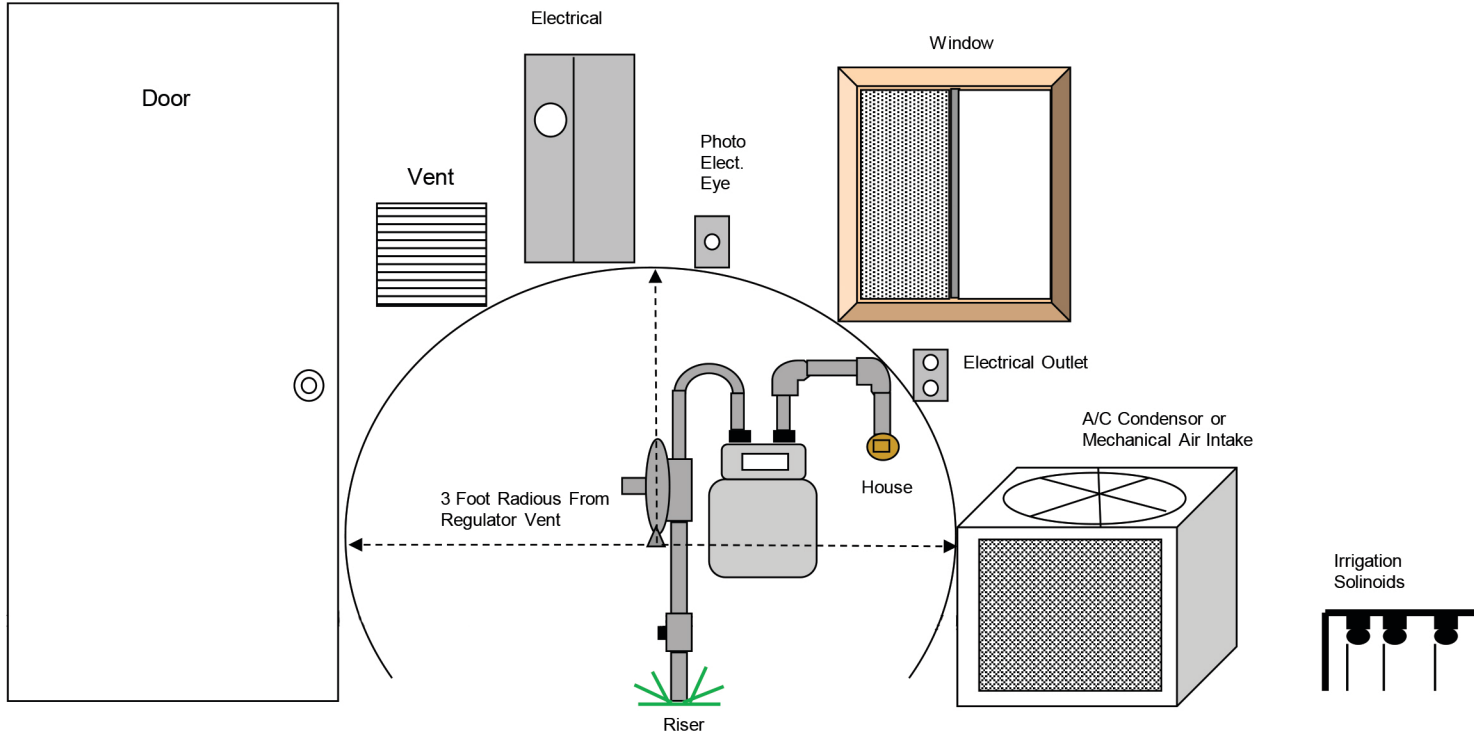

Meter Type	Delivery Pressure	Capacity (CFH)	Outlet Pipe Size	Spread Riser to House Line Left to Right	Clearance off of Wall	Height from Final Grade
AC 250	0.25 psi / 2 psi	250 / 262	2" Threaded Nipple	30" / 30"	18"	2' 6"
AL 425	0.25 psi / 2 psi	425 / 990	2" Threaded Nipple	30" / 30"	18"	2' 6"
AC 630	0.25 psi / 2 psi / 5 psi	630 / 1310 / 1515	2" Threaded Nipple	30" / 30" / 7' 11"	18"	3'
AL 800	0.25 psi / 2 psi / 5 psi	800 / 1870 / 2120	2" Threaded Nipple	30" / 30" / 7' 11"	18"	3'
AL 1000	0.25 psi / 2 psi / 5 psi	1000 / 2330 / 2660	2" Threaded Nipple	30" / 30" / 7' 11"	18"	3'
15C	0.25 psi / 2 psi / 5 psi	1500 / 1640 / 1950	2" Threaded Nipple	7' 11"	24"	3'
3M	0.25 psi / 2 psi / 5 psi	3000 / 3300 / 3900	2" Threaded Nipple	7' 11"	24"	3'

**** Please provide this to your plumber ****